

# COOLING OF HIGH PRESSURE INSULATING GAS FOR 3 MeV DC ACCELERATOR: AN ALTERNATE APPROACH

Shyam Rao Ghodke<sup>#</sup>, Rajesh Barnwal, Mahender Kumar, Susanta Nayak, Vijay Sharma, Suneet Kumar Srivastava, Satyanarayan Acharya, Kavita Pramod Dixit, Israel Bakht Singh, D. Jayaprakash, Rehim Rajan, Dharmendra Kumar Sharma, Suryaprakash Dewangan, Kailash Chander Mittal, Lalit Mohan Gantayet  
 Bhabha Atomic Research Centre, Mumbai, India – 400085

## Abstract

3 MeV Accelerator is working inside the ‘Electron Beam Centre’ (EBC) building at Kharghar, Navi Mumbai. Generally in DC and Pelletron accelerators Nitrogen/SF<sub>6</sub> gas is taken out from accelerator tank and it is cooled by separate heat exchanger and blower unit outside the accelerator tank. In our alternate approach we have designed fan/blower to work under high pressure inside accelerator tank. Fans are designed to work in high pressure SF<sub>6</sub> environment at 7 bar absolute pressure with 42 kg/m<sup>3</sup> SF<sub>6</sub> gas density. Fan through air over radiator type finned tube heat exchanger, installed inside accelerator tank. Fan speeds are controlled through variable frequency drive. Two numbers of such assemblies are fabricated, installed and tested in Nitrogen and SF<sub>6</sub> gas environment at different pressure and variable fan speed. Performances are recorded and plotted in graphical form. These cooling systems are shown excellent performance in last five years. Paper will discuss about design of cooling system, cooling calculation of fan, fabrication of fan and heat exchanger, 5 TR chiller unit, variable frequency drive, fan performance etc.

## INTRODUCTION

3 MeV Accelerator is an electrostatic accelerator in which terminal is floating at a voltage of 3 MV and the accelerator tank is at ground potential. From voltage gradient point of view there is two geometries, coaxial cylindrical and spherical geometry. Design calculations show that SF<sub>6</sub> is the most suitable medium for insulation [7,8] and cooling purpose. Apart from excellent electrical properties, SF<sub>6</sub> has good chemical stability, thermal properties and nontoxic. The Accelerator tank is the main body of the Accelerator, which will house HV multiplier columns, RF electrodes, corona shields, HV terminals, electron gun, accelerating tubes, heat exchangers along with blower, RF transformer etc. All of high voltage components require SF<sub>6</sub> gas insulation and efficient cooling. Hence there is a need of SF<sub>6</sub> gas and its cooling system. Operating pressure of SF<sub>6</sub> gas inside the accelerator tank is 6 bar (g). On line dew point measurement system is connected in accelerator tank. SF<sub>6</sub> gas handling system not discussed in this paper. [1, 2, 3, 4, 5, 6]

<sup>#</sup>ghodke\_barco@yahoo.co.in

## DESIGN OF SF<sub>6</sub> GAS COOLING SYSTEM

The Aim of SF<sub>6</sub> gas cooling system is to cool SF<sub>6</sub> gas inside accelerator and RF transformer tanks with the help of water-SF<sub>6</sub> gas heat exchange process. This system is mainly comprises of 1.5” and 1” SS pipe line, radiator type heat exchanger and blower combination, 5 TR chiller unit, cooling tower, pressure transmitter, temperature sensors, safety interlocks, flow meter, flow transmitter, Variable frequency drive, pressure gauges and other instrumentation.

The blower has been designed and commissioned to achieve desired heat transfer under 6 bar (g) with 42 kg/m<sup>3</sup> density of SF<sub>6</sub> gas. Standard high pressure finned tube bundle with header have been selected as per the area available inside the accelerator tank. Heat exchanger assembly is made of such four numbers of bundles and makes an enclosure of size 800 x 800 x 100 mm (Figure 2 and 4). Blower is fabricated from ASTM A 240 Gr 304L stainless steel plates and it is assembled inside this enclosure and throw SF<sub>6</sub> gas centrifugally outward direction. Two sets of heat exchanger and blower combination along with 2 and 3 HP motors has been installed and tested for desired flow rate, pressure drop and motor current/wattage (table-1). Blower has dynamically balanced to minimize the vibration.

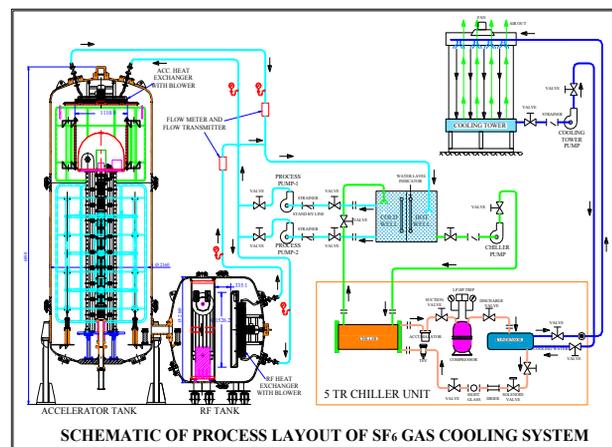


Figure 1: SF<sub>6</sub> Gas Cooling System

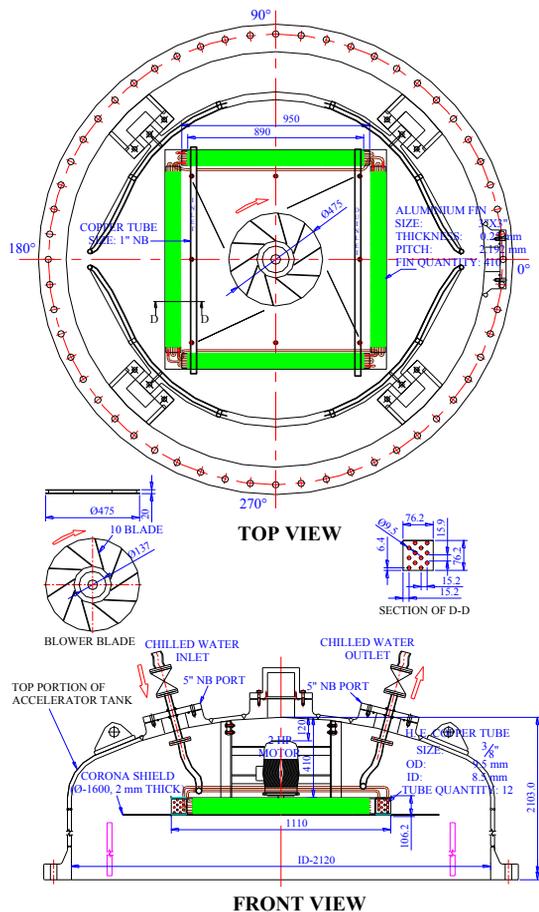


Figure 2: Heat exchanger and Blower assembly inside Accelerator Tank

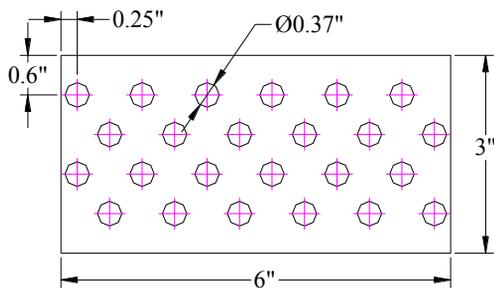


Figure 3: Staggered tube geometry of finned tube heat exchanger



Figure 4: Heat exchanger assembly and blower inside accelerator tank

## COOLING CALCULATIONS

RF Transformer which is having a maximum heat load of 8 kW is maintained within 45°Celsius temperature limit. It was estimated that a total water flow rate is 60 lpm of chilled water at 24°C is required to remove 8 kW heat. Water is circulated through the heat exchanger for cooling of transformer/SF<sub>6</sub> inside the RF tank. Similarly other accelerator tank components having a maximum heat load of 4 kW requires a water flow rate is 35 lpm of chilled water at 24°C. Working temperature kept 22-24°C to avoid condensation. 5 TR chiller unit is designed for chilled water of 110 lpm at 22°C.

Heat transfer calculations are carried out to find out heat transfer coefficient of chiller water side and sf<sub>6</sub> gas side of heat exchanger. Standard finned tube radiator type tube bundles are selected as per space constraint. Staggered geometry used to calculate flow across Banks of tubes as per figure-3. A design calculation for proper surface area of fin tubes and convective heat transfer coefficient in SF<sub>6</sub> environment at a pressure of 6 bar (g) for each bundle have been done.

A classical expression for computing the local Nusselt number for fully developed turbulent flow in a smooth circular tube the Dittus-Boelter equation

$$Nu_D = 0.023 Re_D^{4/5} Pr^n \quad \text{Where } n = 0.4 \text{ for heating and } 0.3 \text{ for cooling}$$

These equations are valid for the range of conditions-

$$0.7 \leq Pr \leq 160 \quad Re_D \geq 10,000 \quad L/D \geq 10$$

where  $Re_D$  is Reynolds number,  $Pr$  is prantle numbe and  $Nu_D$  is Nusset Number.

Calculated heat transfer coefficient in SF<sub>6</sub> gas side is 400 W/m<sup>2</sup>K and on water side it is 8000 W/m<sup>2</sup>K. Over all heat transfer co-efficient is 200 W/m<sup>2</sup>K. Length of tube in tube bundle required is 76 meter.

Chiller plant along with heat exchanger and blower has been working with accelerator over more than 5 years. At low power level we do not run the blower, chilled water in finned tube is sufficient to cool the system. We run the blower for heat load more than 4 kW. Two number of electronic flow metering system installed for remote reading of flow.

## FABRICATION AND TESTING

Fabrication & testing of SF<sub>6</sub> gas cooling system like piping, heat exchanger are carried out as per ASME B31.1 Code for pressure piping. Raw material identified in the form of pipe as per ASME SA 312 TP Gr-304L. Physical, chemical and IGC test carried out.

Welding Performance Specification was carried out as per ASME code SEC-IX. Gas tungsten Arc Welding is used for piping joining. Complete pipeline including all flexible hoses, valves, pressure gauges, flow transmitter, etc was pneumatically tested at a pressure of 11.0 kg/cm<sup>2</sup>(g) and found satisfactory. Tube bundles inside accelerator tank are pneumatically tested at 20 bar pressure.

We have carried out Mass spectrometer leak detector (MSLD) testing of pipe line after hydro test. We have

found leak in flexible bellow. It was decided to use Copper pipe with enough flexibility to give proper connection inside accelerator tank and it should take vibration of blower which is running inside accelerator tank.

### SPEED AND VIBRATION CONTROL WITH VARIABLE FREQUENCY DRIVE

A variable-frequency drive (VFD) is installed with system for controlling the rotational speed of an alternating current electric motor by controlling the frequency of the electric power supplied to the motor. The operating speed of a motor connected to a VFD is varied by changing the frequency of the motor supply voltage.



Figure 5: Rectangular Radiator type Heat Exchanger with Blower assembled inside the Accelerator Tank

We have made the check list to see the different conditions before starting the cooling system. Operating procedure gives guidelines to operate cooling system in different heat load conditions.

During initial testing motor insulation breaks due to over current drawn and over current protection failed. A variable frequency drive installed to control the RPM of motor. It controls current and power limit of motor by controlling the RPM.



Figure 6: VFD, chiller, piping and connection with tank

We have measured the vibration level and natural frequency of accelerator column. Blower RPM are set such a way that its natural frequency should not match with motor frequency. It is set at 18.6 Hz and 16.66 Hz in accelerator tank and transformer tank respectively.

### TEST REPORT

Table 1: i) Test Report of RF Tank Blower At different motor speed:

RF Tank Data: 3HP/2.25kW, 4.5A, 1440RPM, 4 pole Motor, Operating window: 360 - 720 RPM (12-24 Hz) At 33.8°C and 3.0 bar (g) SF <sub>6</sub> gas				
Motor speed RPM	Current, A	Power, kW	Voltage, V	Motor Active Current, A
360	2.49	0.25	103	1.06
400	2.64	0.32	115	1.3
500	3.08	0.55	145	1.93
600	3.71	0.90	176	2.74
720	4.6	1.48	215	3.8

ii) Test Report of Accelerator Tank Blower at different motor speed:

Acc. tank Data: 2HP/1.5kW, 3.2A, 1440RPM, 4 pole Motor, Operating window: 360 - 720RPM (12-24 Hz) At 33.8°C and 3.0 bar (g) SF <sub>6</sub> gas				
Motor speed RPM	Current, A	Power, kW	Voltage	Motor Active Current, A
360	1.66	0.14	102	0.53
400	1.70	0.17	113	0.62
500	1.86	0.28	142	0.94
600	2.11	0.44	173	1.31
720	2.54	0.72	210	1.84

iii) At different Gas Pressure and Motor Speed:

SN	SF <sub>6</sub> gas pressure kg/cm <sup>2</sup> g	Speed rpm	Current Amp	Power kW	Voltage V	MAC Amp
Accelerator Tank						
1	3.0	400	1.70	0.17	113	0.62
2	4.0	400	1.76	0.20	114	0.76
3	5.0	400	1.82	0.23	116	0.91
4	6.0	400	1.91	0.26	117	1.04
5	6.0	560	2.59	0.61	168	1.89
RF Transformer Tank						
1	3.0	360	-----	-----	-----	-----
2	4.0	360	2.6	0.29	104	1.26
3	5.0	360	2.77	0.34	106	1.55
4	6.0	360	2.94	0.39	107	1.78
5	6.0	500	4.11	0.91	153	3.19

### CONCLUSION

The SF<sub>6</sub> gas cooling system with alternate approach is running at desired capacity. Blower was running through variable frequency drive (VFD) at set frequency of RF tank blower is 18.6 Hz (558 rpm) and accelerator tank blower is 16.66 Hz (498 rpm) to avoid resonance.

**REFERENCES**

- [1] ASME Boiler and Pressure Vessel Code SEC-VIII Div-1, SEC-IX, SEC-V, SEC-II (1998 Ed).
- [2] Theory and Design of Pressure Vessel, J. F. Harvey (1990).
- [3] Process Equipment Design, Brownell & Young. (1983).
- [4] Ghodke S. R, et. al. "Tank Design for 3 MeV, 30 kW Industrial Electron Accelerator", InPAC 2003, p-249.
- [5] S R Ghodke, Mahendra Kumar, Rajesh Barnwal, Susanta Nayak, et. al., "Testing and Operational Experience of SF6 Gas Handling System for 3 MeV, 30 kW DC Accelerator at EBC, Kharghar, Navi Mumbai", Indian Particle Accelerator Conference (InPAC-2013-ID-013), 19-22 Nov. 2013, held at VECC, Kolkata.
- [6] S R Ghodke, D. Jayaprakash, Rajesh Barnwal, Mahendra Kumar, Susanta Nayak, S K Shrivastava, et. al., "Testing and Operation of SF6 Gas Handling System for 3 MeV, 30 kW Electron Beam Accelerator at EBC, Kharghar, Navi MUMBAI", International Conference and Exhibition on Pressure Vessel and Piping (OPE 2013, ID: C-011), Kalpakkam, INDIA.
- [7] S. R. Ghodke, Mahendra Kumar, Rajesh Barnwal, Vijay Sharma, Susanta Nayak, R I. Bakhtsing, D Bhattacharjee, Rehim Rajan, D K Sharma, S Dewangan, Rupesh Patel, Seema Gond, N K Lawangare, A Waghmare, K. C. Mittal, L. M. Gantayet "Fabrication of Spark Gap Assembly for 3 MeV DC Accelerator", Indian Particle Accelerator Conference (InPAC-2013-ID-130), 19-22 Nov. 2013, held at VECC, Kolkata.
- [8] S. Dewangan, D. K. Sharma, R. I. Bakhtsingh, R. N. Rajan, V. Sharma, R Barnwal, S. R. Ghodke, S. K. Srivastava, R. Patel, S. Banerjee, Mahendra Kumar, S. Nayak, S. Gond, N. B. Thakur, A. Waghmare, K. C. Mittal and L. M. Gantayet, "Development of High Voltage Surge Limiting Resistor for Protection of HV Multiplier of 3MeV DC Accelerator", Indian Particle Accelerator Conference (InPAC-2013-ID-208), 19-22 Nov. 2013, held at VECC, Kolkata.